

Circuit-breaker, 3p, 100A

Part no. NZMB1-M100 Article no. 265714



Similar to illustration

| Delivery programme | | | |
|---|-----------------|----|--|
| Product range | | | Circuit-breaker |
| Protective function | | | Motor protection |
| Standard/Approval | | | IEC |
| Installation type | | | Fixed |
| Release system | | | Thermomagnetic release |
| Construction size | | | NZM1 |
| Description | | | With phase-failure sensitivity Tripping class 10 A IEC/EN 60947-4-1, IEC/EN 60947-2 The circuit-breaker fulfills all requirements for AC-3 switching category. |
| Number of poles | | | 3 pole |
| Standard equipment | | | Box terminal |
| Switching capacity | | | |
| 400/415 V 50/60 Hz | I _{cu} | kA | 25 |
| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 100 |
| Setting range | | | |
| Overload trip | | | |
| 4 | I _r | А | 80 - 100 |
| Motor rating AC-3 50/60 Hz | | | |
| 380 V 400 V | Р | kW | 45 |
| Motor rating AC-3 50/60 Hz | | | |
| 400 V | Р | kW | 45 |
| Rated operational current AC-3 50/60 Hz | | | |
| 400 V | I _e | Α | 81 |

Technical data

| General | | |
|---|------|--|
| Standards | | IEC/EN 60947 |
| Protection against direct contact | | Finger and back of hand proof to VDE 0106 Part 100 |
| Climatic proofing | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | |
| Ambient temperature, storage | °C | - 40 - + 80 |
| Operation | °C | -25 - +70 |
| Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27 | g | 20 (half-sinusoidal shock 20 ms) |
| Safe isolation to EN 61140 | | |
| Between auxiliary contacts and main contacts | V AC | 500 |
| between the auxiliary contacts | V AC | 300 |
| Mounting position | | Vertical and 90° in all directions With residual-current release XFI: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in adapter elements - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: |

| | | | - NZM3, N3: vertical, 90 ° left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions |
|--|------------------|-------|--|
| Direction of incoming supply | | | as required |
| Degree of protection | | | |
| Device | | | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | | | With insulating surround: IP40 With door coupling rotary handle: IP66 |
| Terminations | | | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) | | | Weight Temperature dependency, Derating Effective power loss |
| Circuit-breakers | | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 100 |
| Rated surge voltage invariability | U _{imp} | | |
| Main contacts | | V | 6000 |
| Auxiliary contacts | | V | 6000 |
| Rated operational voltage | U _e | V AC | 440 |
| Overvoltage category/pollution degree | | | III/3 |
| Rated insulation voltage | Ui | V | 690 |
| Use in unearthed supply systems | | V | ≦ ₄₄₀ |
| Switching capacity | | | |
| Rated short-circuit making capacity | I _{cm} | | |
| 240 V | I _{cm} | kA | 63 |
| 400/415 V | | kA | 53 |
| | I _{cm} | | |
| 440 V 50/60 Hz | I _{cm} | kA | 53 |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | | |
| Icu to IEC/EN 60947 test cycle 0-t-C0 | lcu | kA | |
| 240 V 50/60 Hz | I _{cu} | kA | 30 |
| 400/415 V 50/60 Hz | I _{cu} | kA | 25 |
| 440 V 50/60 Hz | I _{cu} | kA | 25 |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | Ics | kA | |
| 240 V 50/60 Hz | I _{cs} | kA | 30 |
| 400/415 V 50/60 Hz | I _{cs} | kA | 25 |
| 440 V 50/60 Hz | I _{cs} | kA | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Utilization category to IEC/EN 60947-2 | | | A |
| Rated making and breaking capacity | | | |
| Rated operational current | I _e | Α | |
| AC-1 | - | | |
| 380 V 400 V | I _e | Α | 100 |
| 415 V | I _e | Α | 100 |
| AC3 | Ü | | |
| 380 V 400 V | l _e | Α | 81 |
| 415 V | I _e | A | 81 |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | ,, | 20000 |
| Lifespan, electrical | Operations | | |
| AC-1 | | | |
| 400 V 50/60 Hz | Operations | | 7500 |
| 415 V 50/60 Hz | Operations | | 7500 |
| Max. operating frequency | | Ops/h | 120 |
| Current heat losses per pole at $I_{\rm u}$ are based on the maximum rated operational | | W | 16.7 |
| current of the frame size. | | | |

| | | | For current heat loss per pole the specification refers to the maximum rated operational current of the frame size. |
|---|------|-----------------|---|
| Total downtime in a short-circuit | | ms | <10 |
| Terminal capacity | | | |
| Standard equipment | | | Box terminal |
| Overview | | | Basic equipment Box |
| Round copper conductor | | | |
| Box terminal | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 70) 2 x 25 |
| Tunnel terminal | | | |
| Solid | | mm^2 | 1 x 16 |
| Stranded | | mm ² | |
| Stranded | | mm ² | 1 x (25 - 95) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 35) 2 x (25 - 35) |
| Al conductors, Cu cable | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | mm ² | |
| Stranded | | mm ² | 1 x (25 - 95) |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 2 x 9 x 0.8 |
| | max. | mm | 9×9×0.8 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M6 |
| Direct on the switch | | | |
| | min. | mm | 12 x 5 |
| Control cobles | max. | mm | 16 x 5 |
| Control cables | | mm ² | 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) |

Design verification as per IEC/EN 61439

| Technical data for design verification | | | |
|--|------------------|----|-------|
| Rated operational current for specified heat dissipation | In | Α | 100 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 23.85 |
| Operating ambient temperature min. | | °C | -25 |

| Operating ambient temperature max. | °C | 70 |
|--|----|--|
| EC/EN 61439 design verification | | |
| 10.2 Strength of materials and parts | | |
| 10.2.2 Corrosion resistance | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | |
| 10.9.2 Power-frequency electric strength | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | Is the panel builder's responsibility. The specifications for the switch gear must be observed. |
| 10.12 Electromagnetic compatibility | | Is the panel builder's responsibility. The specifications for the switch gear must be observed. |
| 10.13 Mechanical function | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |


Technical data ETIM 6.0


Low-voltage industrial components (EG000017) / Motor protection circuit-breaker (EC000074)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Motor protection circuit-breaker (ecl@ss8.1-27-37-04-01

| [AGZ529013]) | comology / on our broc | and (20 CT KV)// Motor protection broads broaded (concessor) 27 67 61 61 |
|--|------------------------|--|
| Overload release current setting | Α | 80 - 100 |
| Adjustment range undelayed short-circuit release | Α | 800 - 1250 |
| Thermal protection | | No |
| Phase failure sensitive | | Yes |
| Switch off technique | | Thermomagnetic |
| Rated operating voltage | V | 440 - 440 |
| Rated permanent current lu | Α | 100 |
| Rated operation power at AC-3, 230 V | kW | 30 |
| Rated operation power at AC-3, 400 V | kW | 55 |
| Type of electrical connection of main circuit | | - |
| Type of control element | | Rocker lever |
| Device construction | | Built-in device fixed built-in technique |
| With integrated auxiliary switch | | No |
| With integrated under voltage release | | No |
| Number of poles | | 3 |
| Rated short-circuit breaking capacity Icu at 400 V, AC | kA | 25 |
| Degree of protection (IP) | | IP20 |
| Height | mm | 145 |
| Width | mm | 90 |
| Depth | mm | 88 |
| | | |


Characteristics

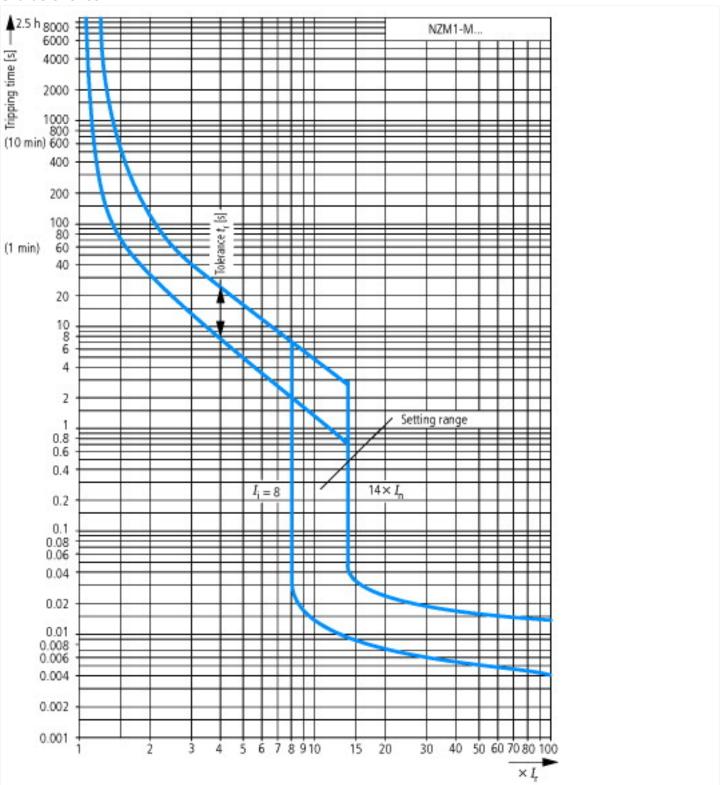


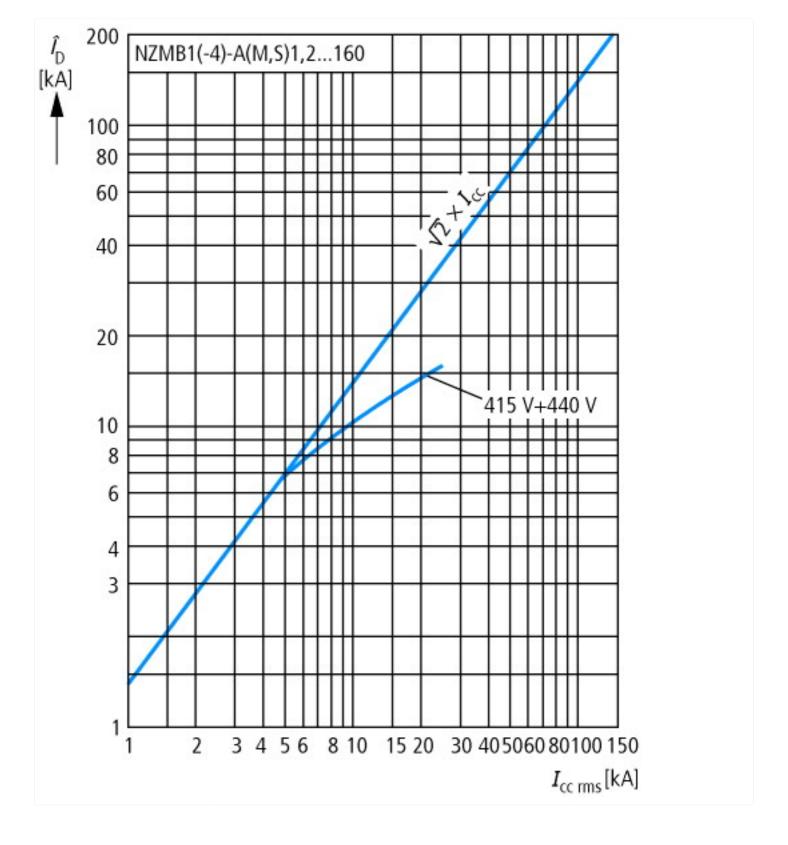

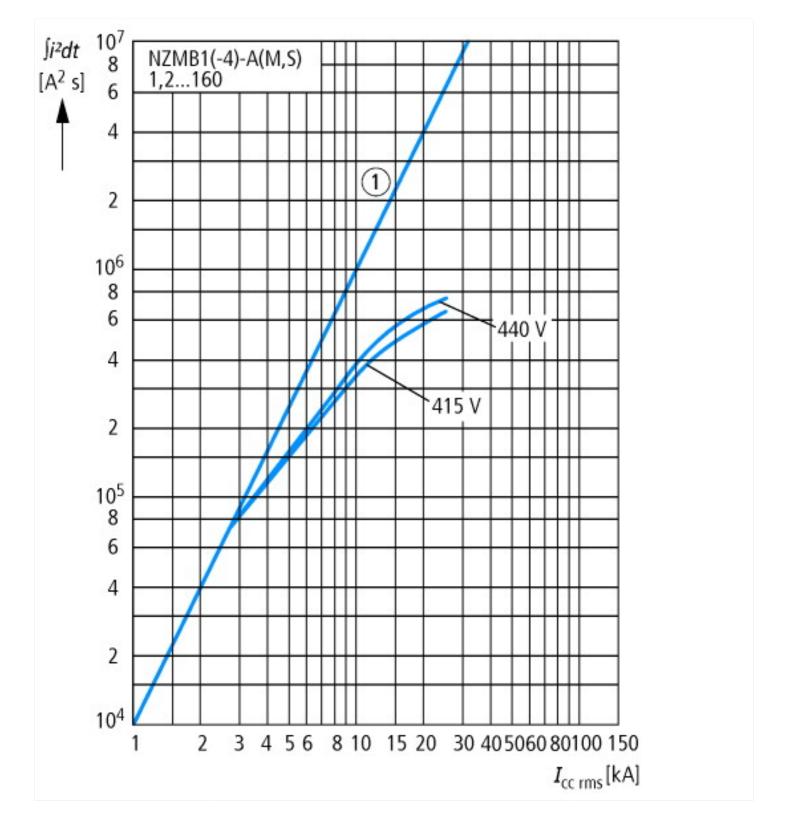

Dimensions

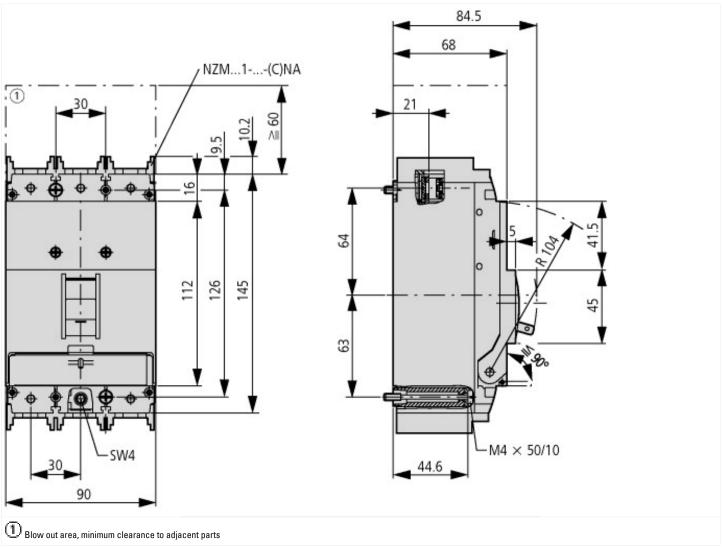

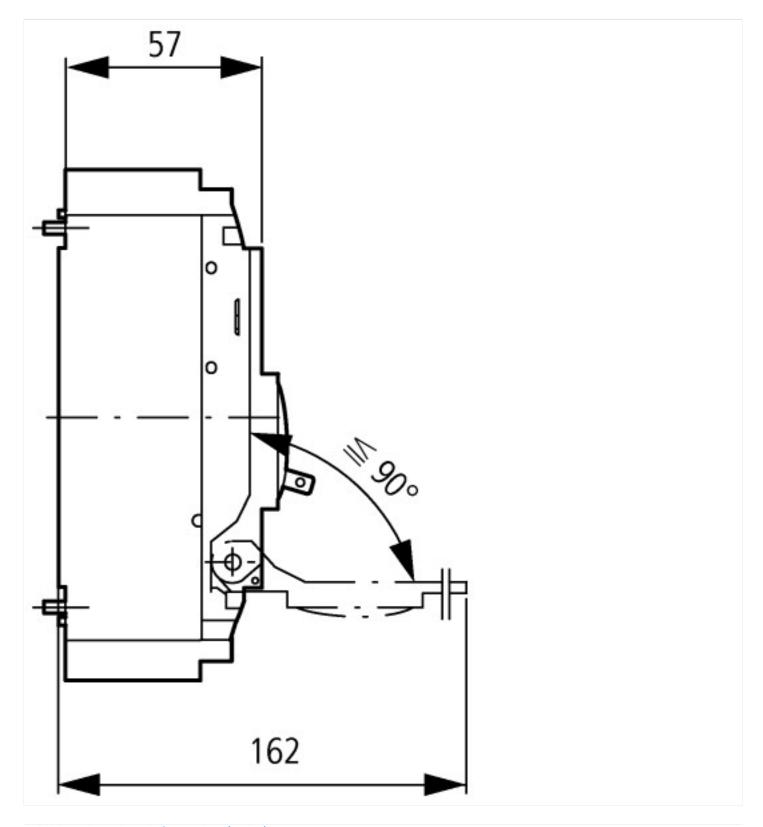

Additional product information (links)

| Additional product information (miks) | | |
|---|---|--|
| IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector | | |
| IL01203004Z (AWA1230-1913) Circuit-breaker, Switch-Disconnector | ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01203004Z2014_07.pdf | |
| Weight | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.171 | |
| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 | |
| Effective power loss | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.174 | |
| Setting-Specific Representation of Tripping Characteristics and Competent Assessment of their Interaction | http://www.moeller.net/binary/ver_techpapers/ver943en.pdf | |
| Busbar Component Adapters for modern Industrial control panels | http://www.moeller.net/binary/ver_techpapers/ver960en.pdf | |